

# Standardised impact sound pressure level according to ISO 140-7

## Field measurements of impact sound insulation of floors

### Wonderwood Floors

### Wonderwood 5.5 mm Hybrid Floor



ABN: 95 632 593 625

E-mail: [info@contrix.com.au](mailto:info@contrix.com.au)

Tel: +61 425 240 555

Add: 12 Ormonde Pde, Hurstville

Testing Date: Friday, 25 November 2022

Test No.: 01

Owner/Pccupier Name: Wonderwood Floors

Testing Location: Residential apartment in Wolli Creek

Floor Finish: Woncderwood 5.5 mm Hybrid Flooring

Acoustic Underlay: --

Sub-base & ceiling below: 200~220 mm reinforced concrete slab (estimated)

100~120 mm suspended ceiling cavity + 10 or 13 mm plasterboard (estimated)

Source Room: Living area on level 17

Receiver Room: Living area on level 16

Receiving room vol: 55.41


Receiver Room Surfaces:

Wall - Plasterboard

Floor Finish - Tiles/Rug

Ceiling - Plasterboard

Frequency, f [Hz]	L'nT (one-third octave)
Hz	dB
50	49.0
63	44.0
80	43.6
100	42.2
125	40.1
160	44.8
200	44.8
250	39.1
315	36.7
400	33.8
500	35.7
630	35.5
800	28.9
1 000	24.3
1 250	16.2
1 600	12.6
2 000	9.2
2 500	9.5
3 150	10.2
4 000	10.5
5 000	11.3

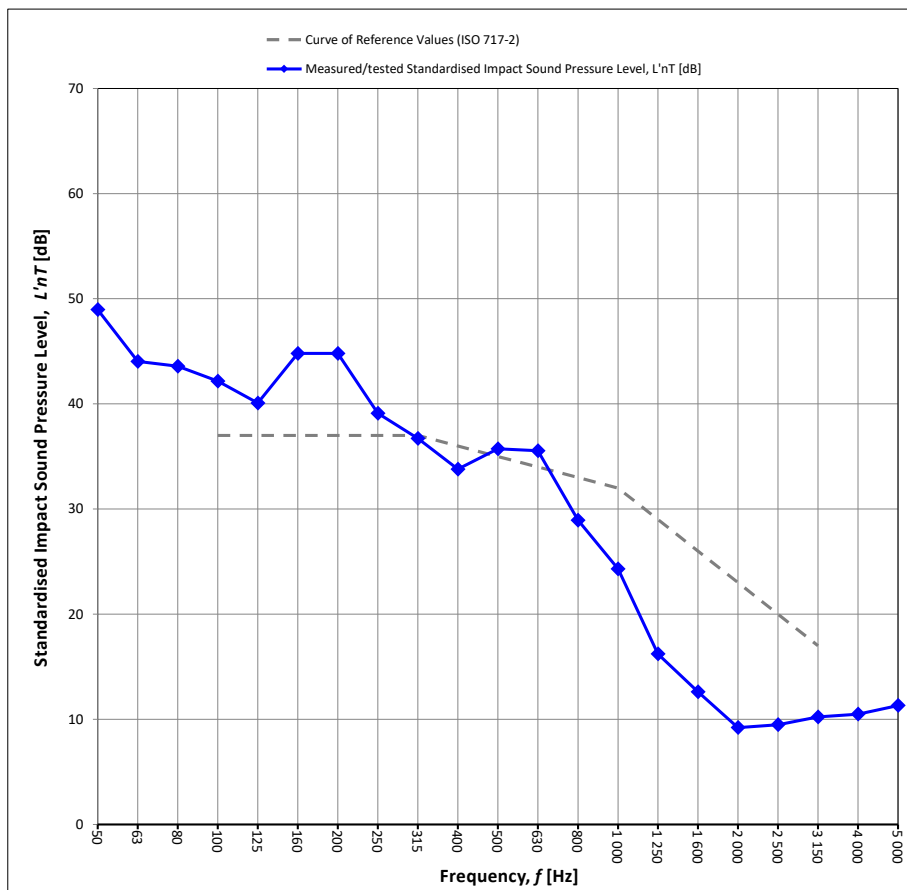

#### Acoustical Rating

Measured Weighted Standardised Sound Level Difference, L'nTw **35** AS ISO 717.2 - 2004

Field Impact Isolation Class, FIIC **72** ASTM E1007-14

AAAC Star Rating **6 Star** AAAC Guideline

Evaluation based on field measurement results obtained by an engineering method

Testing Date : Friday, 25 November 2022

Ref No. : 2001

Testing Organisation: Contrix Pty Ltd

Tested By: Michael Fan Chiang

BE(Mech.), MAAS

**CONTRIX**  
NOISE IMPACT ASSESSMENT  
TESTING & CERTIFICATION

#### Disclaimers:

- The information provided in this report relates to sound insulation of floor coverings & underlays only.
- Contrix Pty Ltd does not provide products or installation services of hard floor coverings/underlay, therefore, not responsible or liable for any product defects.
- This testing report is site-specific and only applies to the subject premise for the tested product as specified in this document.
- The test results can vary from building to building, therefore, this document is not an acoustical certification of the tested products, however, provides information for the design guide only.
- It is highly recommended to engage a qualified acoustic consultant to conduct in-situ testing (field testing) prior to flooring installation. Contact Contrix Pty Ltd on +61 425 240 555 to arrange for field testing.